


## Case Study

WaterSignal data reflects the serious water leak experienced by an Atlanta area property on 9/24/2009. Site pictures below show a section of 3" Schedule 80 PVC pipe that had slipped out of its fitting due to shifting soil during heavy rain conditions. Water to property was cut off 5 hours for repair.



### Hourly Water Usage for 09/24/2009

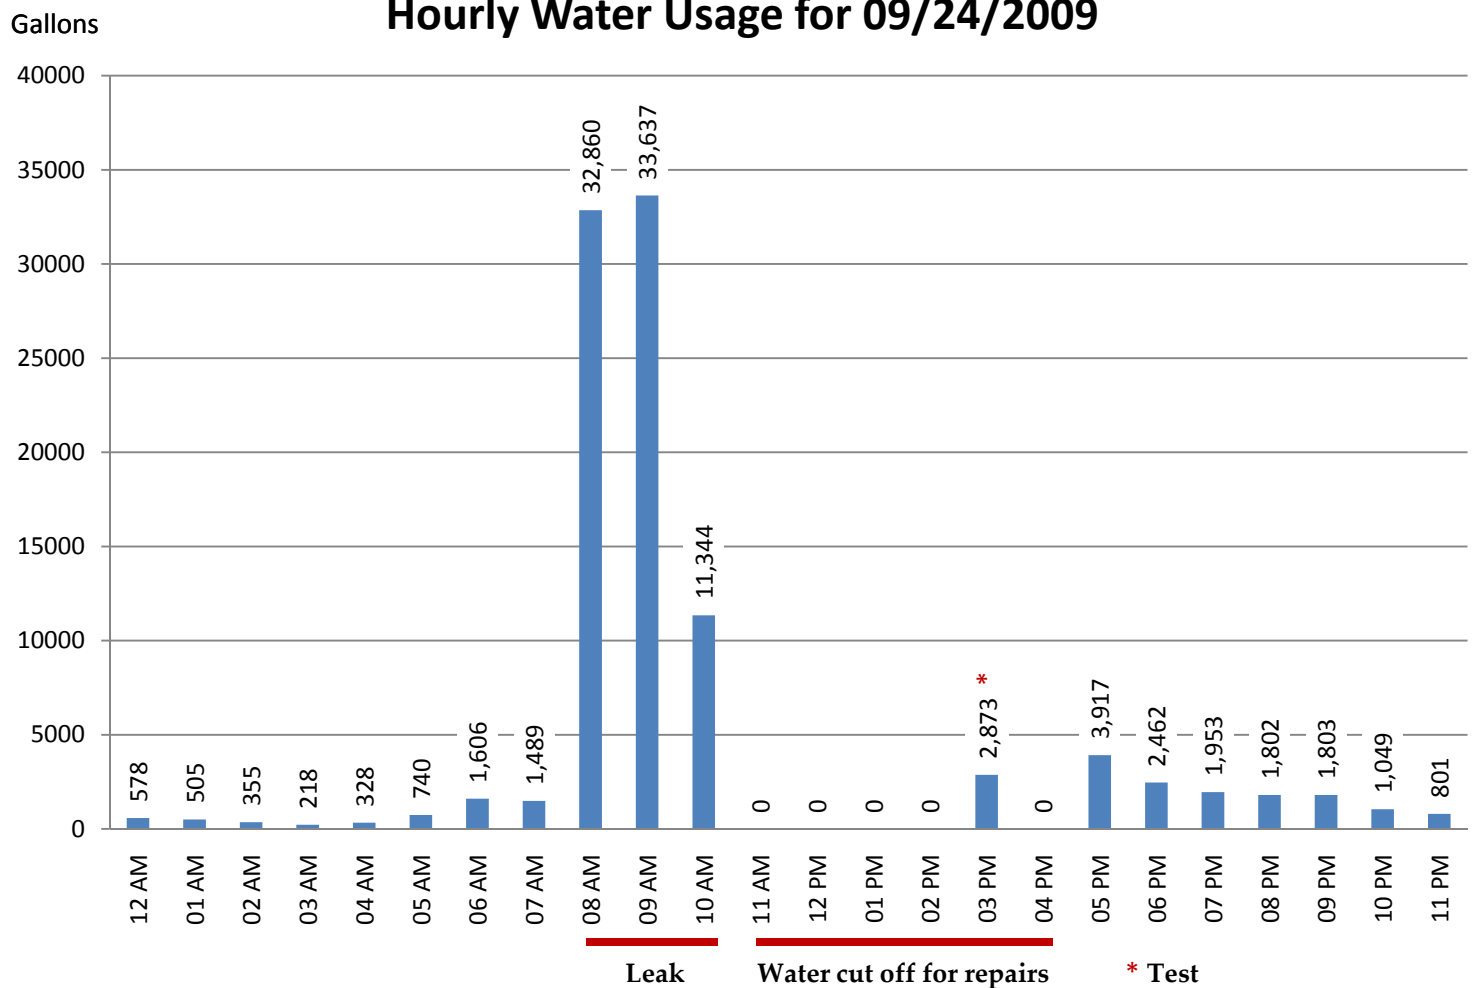

During the hours when the leak was active, more than 75,000 gallons of water was lost at a cost of over \$1,700.